

DIMENSIONS FOR INTEGRAL HOUSING
 MEETS NEMA 1-5, (4X), 7, 9, & 12

CERTIFIED	by _____				
PO #	_____				
ENG	_____				
USER	_____				
		2	9-98-244	GLM	10-1-98
		1	5-96-342	GLM	10-24-96
DE #	ISS	EDO/DSR NO.	APP'D	DATE	

COPYRIGHT 1998
 DREXELBROOK ENG CO.
 SCALE NONE
 UNLESS OTHERWISE STATED
 ALL DIMENSIONS IN INCHES (MM)
 DR. JJS 9-17-98
 CK. AJK



DREXELBROOK
 Engineering Company
 205 KEITH VALLEY RD
 HORSHAM, PA 19044-9986
 215-674-1234
 FAX 215-674-2731

INTEGRAL 120/240 VAC
 DUAL VERIGAP SWITCH
 MOUNTING

504-1060-1-CD1


SHT. 1	ISS
OF 2	2

ALARM RELAY (DPDT)
(TYPICAL TWO BOARDS)

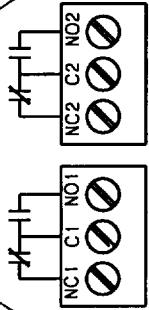

FAIL SAFE SWITCH


SENSOR CONNECTIONS
(TYPICAL TWO BOARDS)

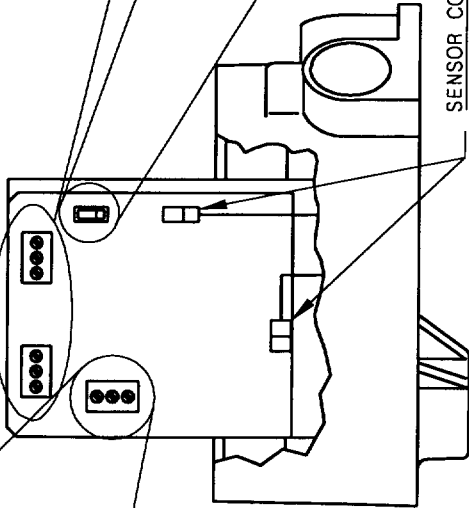

LINE POWER
120/240 VAC
(TYPICAL TWO BOARDS)

SENSOR WIRE

WITH **BLACK** HEAT SHRINK
HIGH POINT BOARD




LINE POWER
120/240 VAC
50/60 HZ


NOTE: RECOMMENDED
MAXIMUM #14 AWG
STRANDED WIRE.

SENSOR WIRE

WITH **BLUE** HEAT SHRINK
LOW POINT BOARD

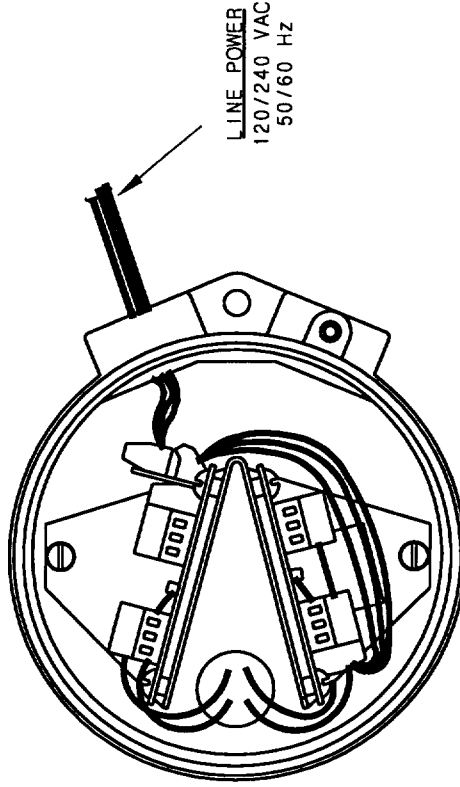

LINE POWER
120/240 VAC
50/60 HZ



DREXELBROOK

Engineering Company

205 KEITH VALLEY RD
HORSHAM, PA 19044-9988
215-874-1234
FAX 215-874-2731

INTEGRAL 24 VDC
DUAL VERIGAP SWITCH
WIRING

504-1060-1-CD1

SHT. 2
OF 2

CERTIFIED	by	COPYRIGHT	1998
PO #		DREXELBROOK ENG CO.	
ENG		SCALE	NONE
USER		UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (DIM)	
		DR.	JJS 9-17-98
		DATE	10-24-96
ISS. EDO/DSR NO.	APP'D	CK.	ASK
DE #			

ISS OF 2