


ITEM	DESCRIPTION	PART NO	REQ'D	REMARKS
------	-------------	---------	-------	---------

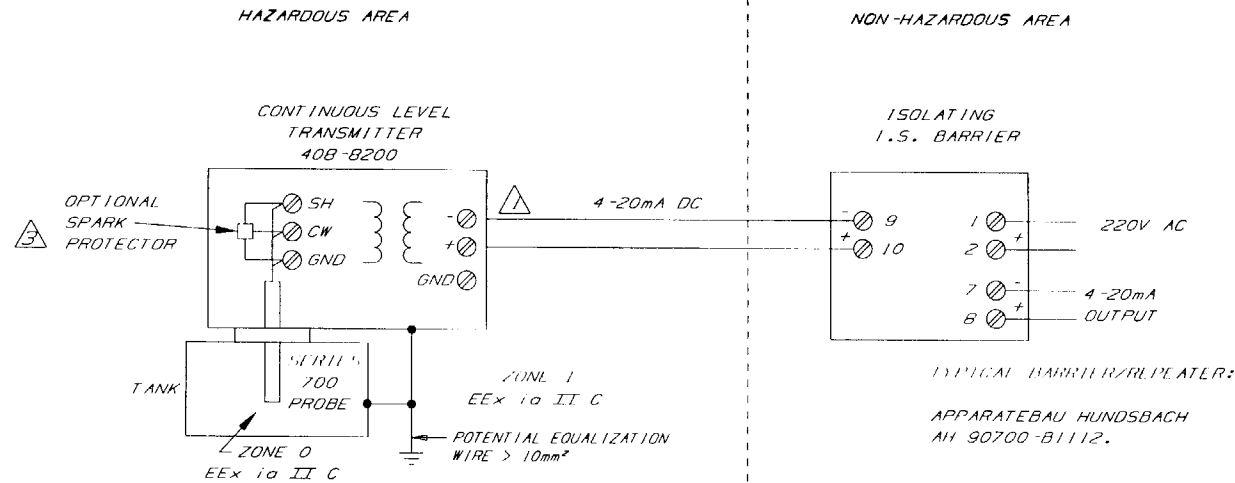


APPROVED DRAWING
 CHANGES TO THIS DRAWING
 REQUIRE AGENCY APPROVAL
 PER 440-0015-003

FM CSA IEC

420-4-17

Δ NOTES:

- ① 1 TRANSMITTER INPUT PARAMETERS: $C_i = .0022\mu F$,
 $L_i = 0mH$, $U_i = 30V$, $I_i = 100mA$, $P_i = 1W$.
- 2 SEE 420-0004-006 FOR INTEGRAL ELECTRONICS AND
 TYPICAL RAIL MOUNTED 24V SUPPLY REPEATER.
- 3 SPARK PROTECTOR MAY BE MOUNTED
 PER 377-1-24-CD.

CONFIDENTIAL				COPYRIGHT 1997	
PROPERTY OF DREXELBROOK ENG CO NO TRANSMITTAL OR DISCLOSURE WITHOUT PRIOR WRITTEN APPROVAL SEE 440-15-21				DREXELBROOK ENG CO	
				SCALE NONE	
				UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	
				TOLERANCES UNLESS OTHERWISE STATED	
				DECIMAL XX 010	
				FRACTIONS 1/64	
				ANGLE 1/2	
				DR COW	
				CK	
				<input type="checkbox"/> LAST REVISION	
ISS	EDO/DSR NO	APP'D	DATE	B 420-4-6	
				 DREXELBROOK Engineering Company CONTROL DRAWING KEMA 40B-8200 WITH INTEGRAL ELECTRONICS	
				SHT 1 OF 1 ISS 1 OF 1	

NO 420-4-6 SHT 1 OF 1