

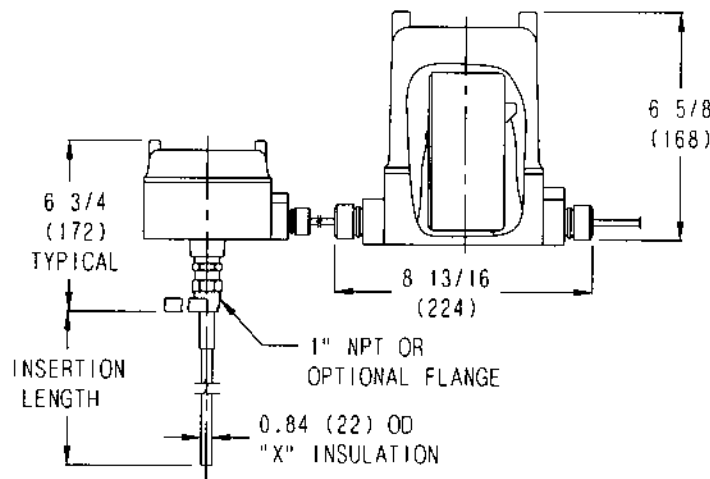
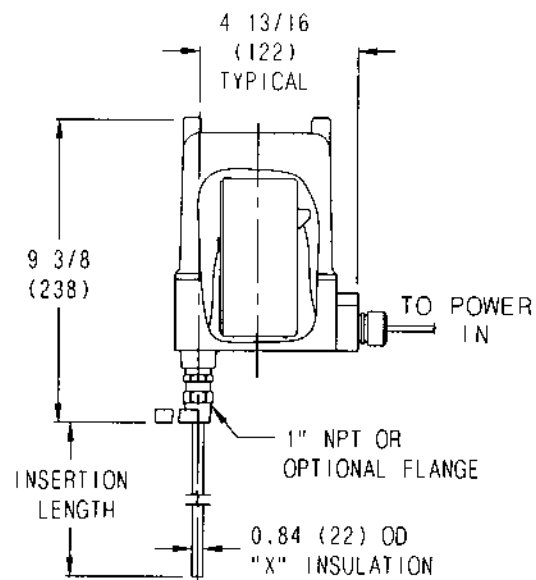
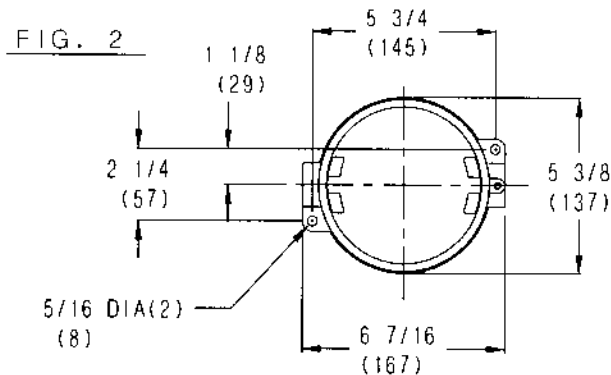


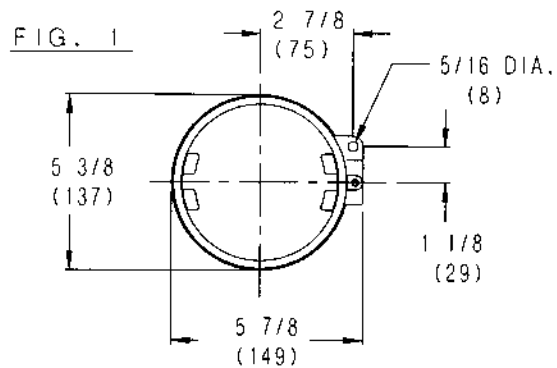


INTEGRAL MOUNTING OF CHASSIS
IN EXPLOSION-PROOF HOUSING

REMOTE MOUNTING OF CHASSIS
IN EXPLOSION-PROOF HOUSING

MAX. PRESSURE RATING: 500 PSI @ 250°F
1000 PSI @ 100°F

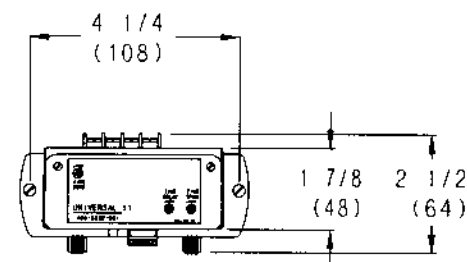

TOP VIEW

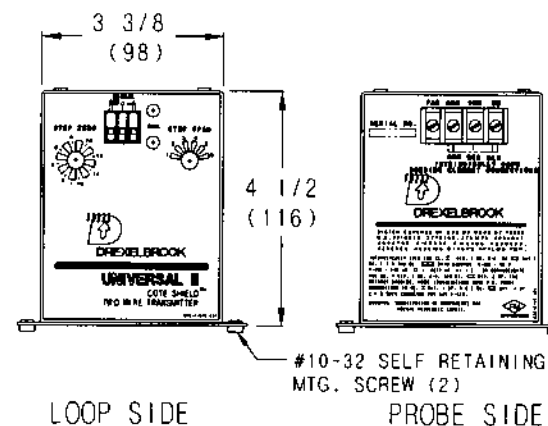

LOOP SIDE

PROBE SIDE

CHASSIS OUTLINE AND
MOUNTING DIMENSIONS

CERTIFIED	by					COPYRIGHT 1998
PG #						DREXELBROOK ENG CO.
ENG						SCALE NONE
USER						UNLESS OTHERWISE STATED
						ALL DIMENSIONS IN INCHES (MM)
		1	3-98-249	DWK 4/30/98		DR. AJK
DE #		ISS.	EDO/DSR NO.	APP'D	DATE	CK. <i>[Signature]</i>



DREXELBROOK
Engineering Company

205 KEITH VALLEY RD
HORSHAM, PA 19044-9986

215-674-1234
FAX 215-674-2731

MOUNTING DIMENSIONS
FOR 508-49-X17
TWO WIRE
RF LEVEL TRANSMITTER

418-2-84-CD

SHT. 1 OF 2
ISS. 1

