
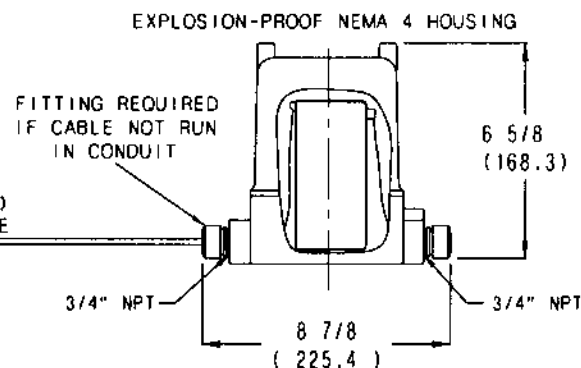
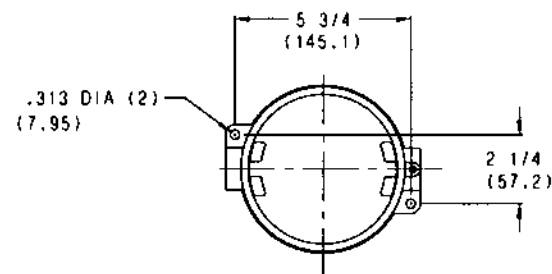


STANDARD SENSING ELEMENT DIMENSIONS

I	A	CSL	C
INACTIVE			
6"	8"	9"	10 1/2"
(152.4)	(203.2)	(228.6)	(266.7)

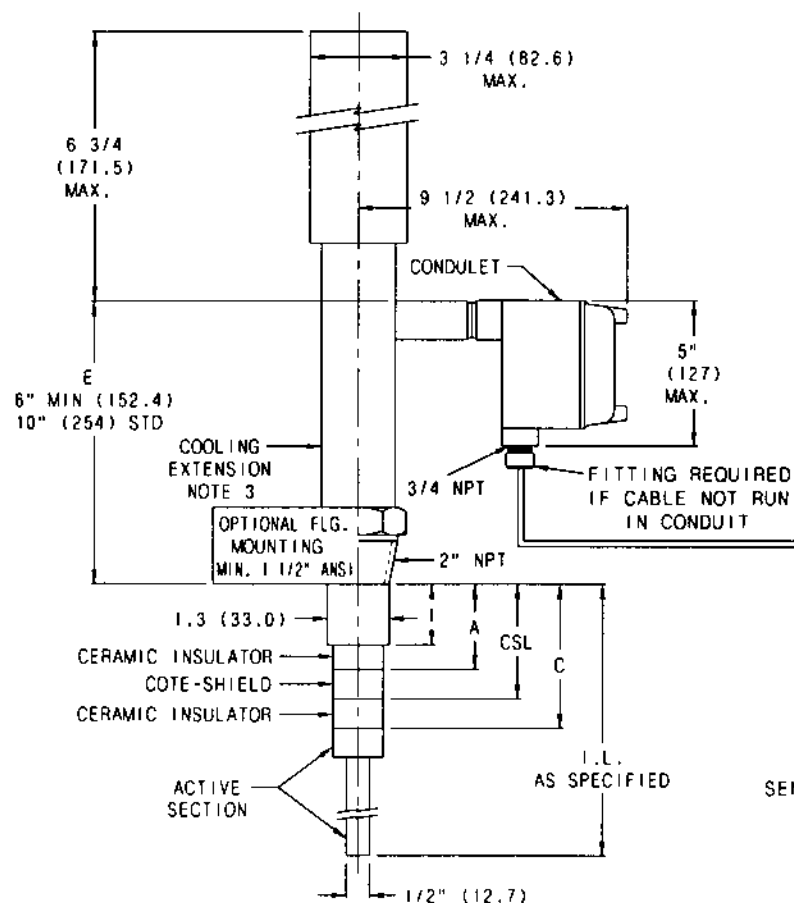

SENSING ELEMENT NOTES

1. ALL WETTED METAL PARTS 316 STANDARD.
2. IF CSL IS INCREASED OR DECREASED, DIMENSIONS A, C, & I INCREASE OR DECREASE BY SAME AMOUNT.
3. TO INCREASE OR DECREASE COOLING EXTENSION, INCREASE OR DECREASE E DIMENSIONS.

CERTIFIED

by

PO #

ENG

USER

DE #

COPYRIGHT 1998

DREXELBROOK ENG CO.

SCALE NONE

UNLESS OTHERWISE STATED
ALL DIMENSIONS IN INCHES (MM)

DR. CDW

CK. ASK

1 12-98-243 DL 1/99

ISS. EDO/DSR NO. APP'D DATE



DREXELBROOK


Engineering Company

205 KEITH VALLEY RD
HORSHAM, PA 19044-9986215-674-1234
FAX 215-674-2731MOUNTING DIMENSIONS
FOR 508-47-722
TWO WIRE LEVEL TRANSMITTER
4-20 mA OUTPUT

418-2-88-CD


SHT. 1 OF 2
ISS. 1

SENSING ELEMENT WIRING

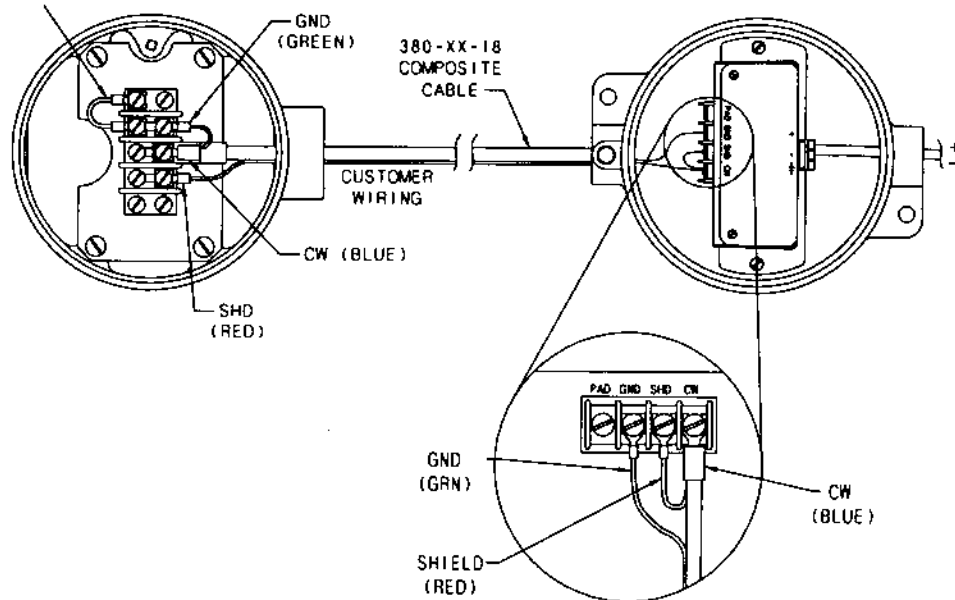INTERNAL WIRING
BY DREXELBROOK

ELECTRONIC UNIT WIRING

INDIVIDUAL LOOP COMPONENT WIRING

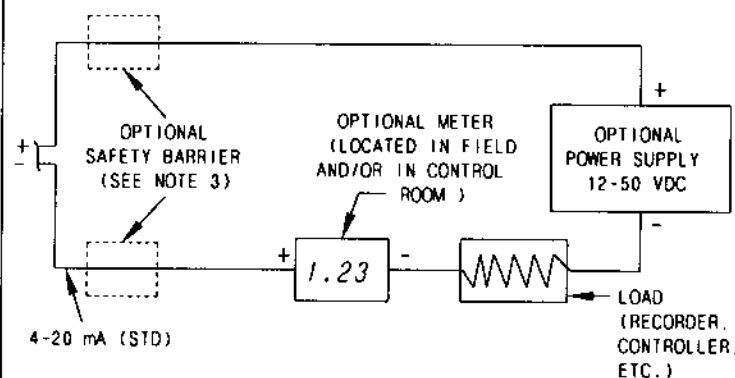HAZARDOUS
AREANONHAZARDOUS
AREA

NOTES:

- 1 ALL DEVICES MUST BE WIRED IN SERIES. VOLTAGE DRIVEN DEVICES REQUIRE A SERIES VOLTAGE DROPPING RESISTOR.
- 2 SIGNAL TERMINALS + & - CAN OPERATE WITH MINIMUM OF 12.0 VDC WITH 20ma FLOWING.
- 3 IF THE FIELD WIRING IS TO BE IN HAZARDOUS AREAS, THEN SUITABLE SAFETY BARRIERS ARE REQUIRED BETWEEN THE POWER SUPPLY AND THE FIELD TO PROVIDE FOR INTRINSICALLY SAFE FIELD WIRING.

CERTIFIED	by					COPYRIGHT 1998
PO #						DREXELBROOK ENG CO.
ENG						SCALE NONE
USER						UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)
		1	12-98-243	DL	1/99	DR. CDW
		ISS.	EDO/DSR NO.	APP'D	DATE	CK. ASK



DREXELBROOK
Engineering Company

15111 VALLEY RD
PA 19044-9986

215-674-1234
FAX 215-674-2731

WIRING DIAGRAM
FOR 508-47-722
TWO WIRE LEVEL TRANSMITTER
4-20 mA OUTPUT

418-2-88-CD

SHT. 2
OF 2
ISS. 1